

INVERT TABLE

RIM=21.0 R=24.0 RIM=22.0 RIM=22.0 INV. OUT=17.6 INV. IN=20.6 (ROOF) INV. OUT=18.6 INV. OUT=18.6 INV. OUT=16.0

INV. IN=17.4 (CB3) INV. OUT=17.3

RIM = 20.5RIM = 24.7INV. OUT=17.1 INV. IN=20.9 (ROOF) INV. IN=17.6 (CB4)


DMH2 RIM=21.7

INV. IN=16.6 (CB5) INV. IN=15.8 (DMH1)
INV. IN=14.4 (CB2)
INV. OUT=14.3



PROP. RETAINING WALL

PROP. CATCH BASIN 226 PROP. SPOT GRADE ■ PROP. OUTLET STRUCTURE

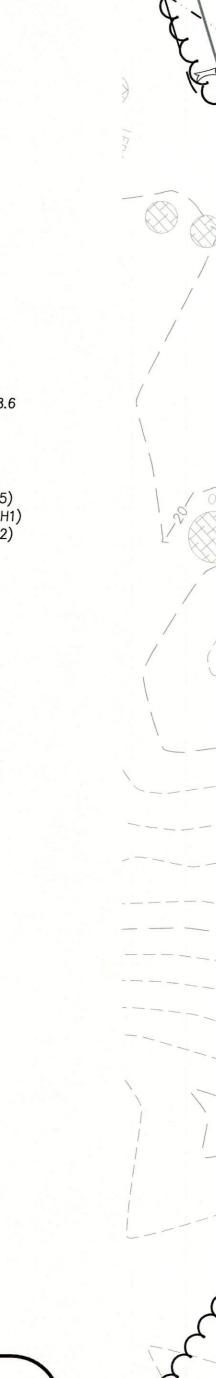

LEGEND EXIST. CONTOUR


EXIST. CATCH BASIN © EXIST. UTILITY POLE WETLANDS EXIST. TEST PIT

TOTAL BUFFER ZONE IMPACT 0' – 50' BUFFER ZONE 50' – 100' BUFFER ZONE

-8" HDPE W/FLARED END INV. OUT=11.7 -8" HDPE W/FLARED END SIED
INV. OUT=13.0 PROP. EMERGENCY-SPILLWAY, ELEV.=14.5 (SEE DETAILS) -PROP. SEDIMENT **FOREBAY** (BOTTOM=12.0, SPILLWAY=14.0) PROP. 1,500 GALLON
OIL/WATER SEPARATOR
RIM=22.0
INV. IN=14.2
INV. OUT=14.1 12" HDPE— W/FLARED END INV. OUT=14.0 BORDERING VEGETATED WETLANDS 6,500 S.F. BUILDING F.F.=25.1 T.B.M.

MAGNETIC NAIL SET

ELEV.= 24.21 (NAVD 1988) PLANT LEGEND **DECIDIOUS TREES** SIZE 2.0" - 2.5" Cal. Zone: 2 Quercus palustris 1.5" - 2.0" Cal. Acer rubrum Red maple BORDERING WEGETATED - PROPOSED STABILIZED
CONSTRUCTION ENTRANCE
(SEE DETAIL) ORNAMENTAL TREES SIZE WETLANDS 1" - 1.5" Cal. Stewartia

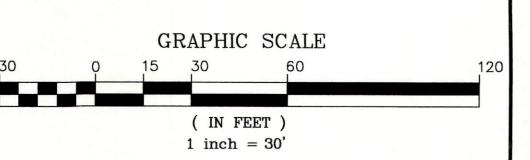



K & R CONSTRUCTION COMPANY LLC P.O. BOX 163

BOXFORD, MA 01921

PREPARED FOR

6	3/15/21	REDUCE SIZE OF BUILDING	C.M.Y.	/ MILLE
5	2/11/21	ADD TREES WITHIN ROW	C.M.Y.	ENGINEERIN
4	2/8/21	ADDRESS CONCOM COMMENTS	C.M.Y.	62 ELM ST.
3	12/28/20	ADDRESS REVIEWER'S COMMENTS	C.M.Y.	13 HAMPTON
2	12/1/20	ADDRESS REVIEWER'S COMMENTS	C.M.Y.	Y
1	9/30/20	ADDRESS TOWN COMMENTS	C.M.Y.	SCALE: 1"=30'
NO.	DATE	DESCRIPTION	BY	DATE: JUL. 20, 2020

N	
	MILLEN
MEI	ENGINEERIN
	62 ELM ST.
	13 HAMPTON

NNIUM ENGINEERING, INC. NG AND LAND SURVEYING . SALISBURY, MA 01952 (978) 463-8980 N RD. EXETER, NH 03833 (603) 778-0528

DESG. BY: C.M.Y.

CHKD. BY: E.W.B.

ERING, INC.	PLAN OF LAND NEWBURY, MA
(978) 463–8980 3 (603) 778–0528	SHOWING PROPOSED CONDITIONS
PROJECT: M193680	84 BOSTON ROAD

Cornus Kousa Kousa Dogwood

Single Stem

RESOURCE AREA IMPACTS

= 59,000 S.F.

= 23,500 S.F. = 35,500 S.F.

GRADING PLAN

SHEET: C-3

QTY

QTY

NOTES

NOTES

Zone: 4

Zone: 5

Zone: 5

1" - 1.5" Cal

1" - 1.5" Cal

(MAP R-36 LOT 23A)

Salt: Medium


Salt: Tolerant

Salt: Tolerant

Salt: Medium

Salt: Medium

E:\sdskproj-2019\M193680\dwg\M193680-D-alt.dwg 3/14/2021 11:18:46 AM EDT

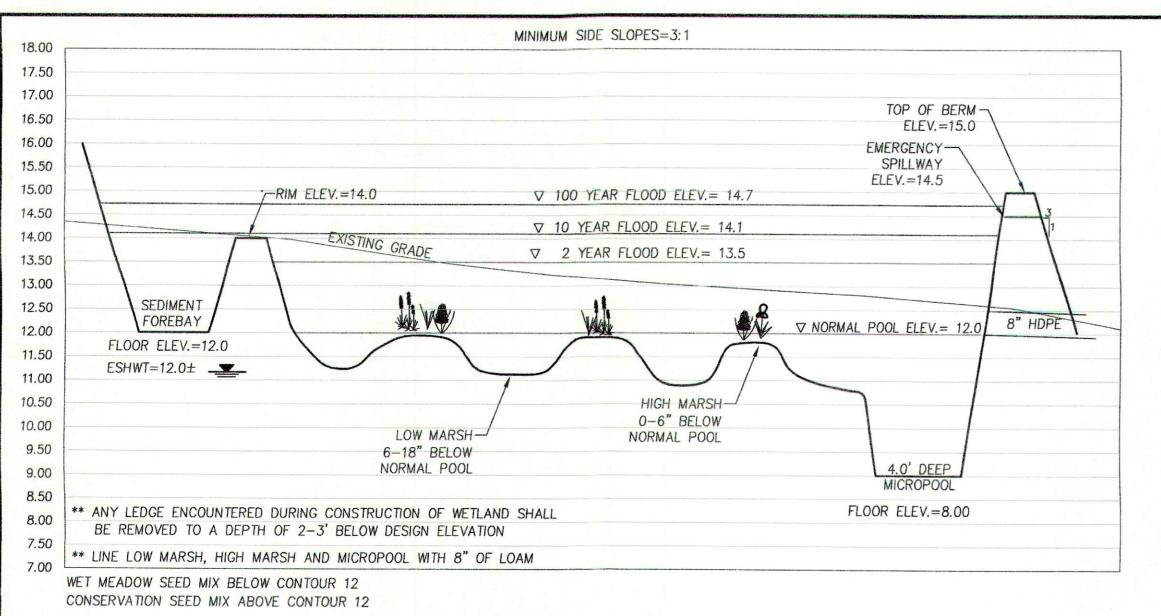

CONSTRUCTED WETLAND PLANT LIST									
SYMBOL	COMMON NAME	LATIN NAME	HEIGHT	NUMBER	ZONE				
0	SWEET PEPPERBUSH	CLETHRA ALNIFOLIA	3-4'	4	HIGH MARSH/SLOPE				
(2)	NORTHERN ARROWWOOD	VIBURNUM DENTATUM	3-4'	4	HIGH MARSH/LOWER SLOPE				
3	WINTERBERRY HOLLY	ILEX VERTICILLATA	3-4'	(INCL. 1 MALE)	HIGH MARSH				
4	HIGHBUSH BLUEBERRY	VACCINIUM CORYMBOSUM	3-4'	4	HIGH MARSH/LOWER SLOPE				
(5)	RED-OSIER DOGWOOD	CORNUS SERICEA	3-4'	4	HIGH MARSH/LOWER SLOPE				
6	BLUE FLAG IRIS	IRIS VERSICOLOR	2" PLUGS	20	HI MARSH/LO MARSH BORDER				
0	CARDINAL FLOWER	LOBELIA CARDINALIS	2" PLUGS	20	EDGE HI MARSH/LO MARSH INTO HIGH MARSH				
0	SOFT-STEM BULRUSH	SCHOENOPLECTUS TABERNAEMONTANI	2" PLUGS	10	LO SLOPE/MICROPOOL EDGE				
0	GREEN BULRUSH	SCIRPUS ATROVIRENS	2" PLUGS	10	MID/LOWER MICROPOOL SLOPE				
10	CHAIRMAKER'S BULRUSH	SCHOENOPLECTUS (SCIRPUS) AMERICANUS	2" PLUGS	10	MID/LOWER MICROPOOL SLOPE				
10	SWEETFLAG	ACORUS AMERICANUS	2" PLUGS	10	MID/LOWER MICROPOOL SLOPE				

CONSTRUCTED WETLAND PROFILE VIEW


HORIZ. SCALE: N.T.S. VERT. SCALE: 1"=2"


GENERAL NOTES FOR CONSTRUCTED WETLANDS:

WETLAND BERMS SHALL BE CONSTRUCTED OF FILL MATERIAL FREE OF ROOTS, STUMPS, WOOD, RUBBISH, STONES GREATER THAN 6", OR OTHER OBJECTIONABLE MATERIALS. FILL MATERIAL FOR THE CENTER OF THE BERM SHALL CONFORM TO UNIFIED SOIL CLASSIFICATION GC, SC, CH, OR CL AND HAVE AT LEAST 30% PASSING THE #200 SIEVE. MATERIALS USED IN THE OUTER SHELL OF THE BERMS SHALL BE CAPABLE OF SUPPORTING THE VEGETATION SPECIFIED ON THE PLANS.

FILL MATERIALS SHALL BE PLACED IN MAXIMUM 8-INCH LIFTS AND COMPACTED WITH A MINIMUM REQUIRED DENSITY OF NOT LESS THAN 95% OF MAXIMUM DRY DENSITY. PRIOR TO FILL MATERIAL INSTALLATION, ALL TOPSOIL, SUBSOIL, AND UNSUITABLE MATERIAL (i.e. LEDGE) SHALL BE REMOVED AND REPLACED WITH SUITABLE MATERIAL. EROSION CONTROL MATTING SHALL BE INSTALLED ON ALL OUTSIDE SLOPES OF STORMWATER BASINS. MATTING SHALL BE A WOVEN JUTE MESH MANUFACTURED BY

MACCAFERRI COMPANY, OR APPROVED EQUAL. 5. ALL PIPING WITHIN CONSTRUCTED WETLAND BERMS SHALL INCLUDE ANTI-SEEPAGE COLLARS.

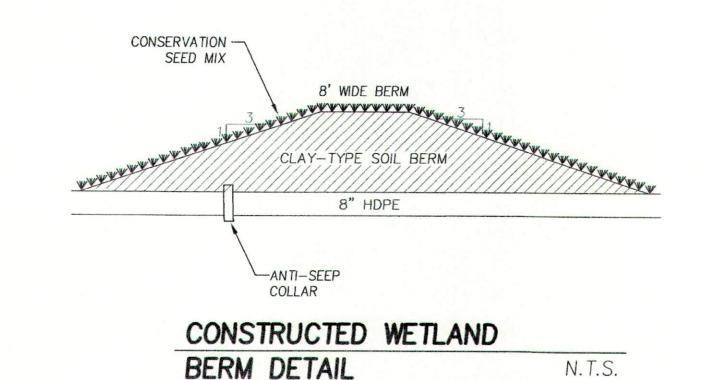

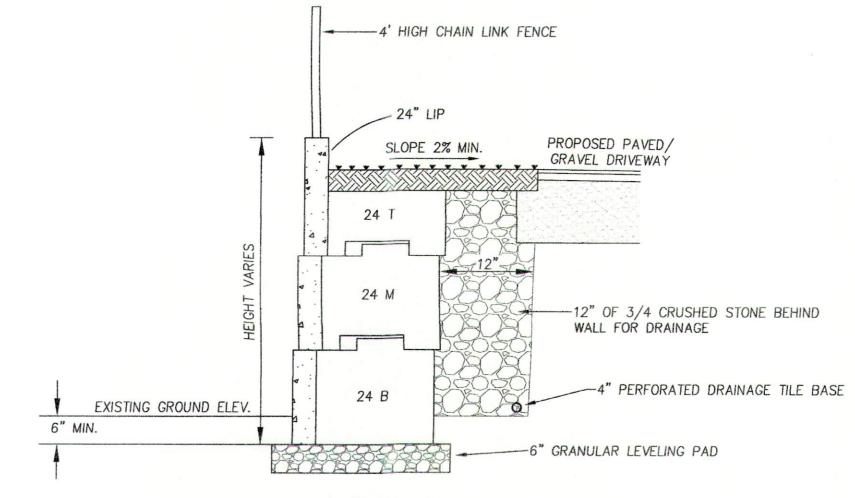

PRIOR TO INSTALLATION CONTRACTOR SHALL PROVIDE A STRUCTURAL DESIGN OF THE WALL WHEN GREATER THAN 4' IN HEIGHT. DESIGN SHALL BE STAMPED AND SIGNED BY A STRUCTURAL ENGINEER CERTIFIED IN MASSACHUSETTS.


CONCRETE BLOCK RETAINING WALL (BY SHEA OR APPROVED EQUAL)

N.T.S.

GRANITE SLOPED EDGING -TYPE SA 6" REVEAL TYP. 6" LOAM & SEED--CEMENT CONCRETE (MDOT SECT. M4)


N.T.S.

TYPICAL SLOPED EDGING DETAIL N.T.S.



PAINTED HANDICAP PARKING SYMBOL

N.T.S.

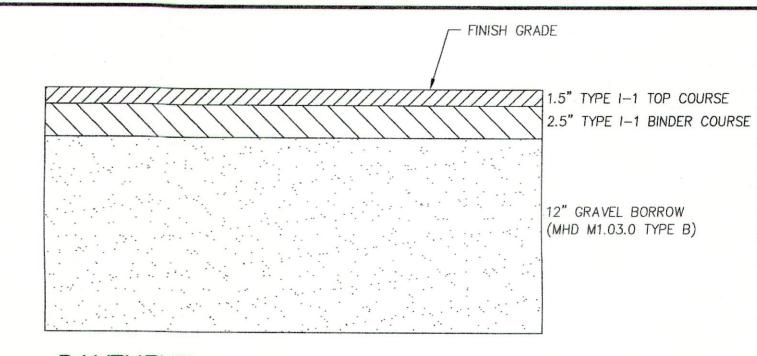


PAVEMENT

DETAIL

N.T.S.

PAVEMENT NOTES


- 1.) ALL STUMPS, ROCKS AND LEDGE WITHIN THE LIMITS OF THE PROPOSED PAVED WAY SHALL BE REMOVED. ALL LEDGE SHALL BE REMOVED TO A MINIMUM DEPTH OF 2' BELOW FINISHED PAVEMENT GRADE.
- 2.) PAVEMENT SHALL NOT BE CONSTRUCTED DURING FREEZING WEATHER OR ON WET OR FROZEN SUBGRADE.
- 3.) GRADING AND ROLLING SHALL BE REQUIRED TO PROVIDE A SMOOTH, EVEN, AND UNIFORM COMPACTED BASE WHICH IS
- COMPACTED TO A MINIMUM DRY DENSITY OF 95 PERCENT. 4.) ALL UNSUITABLE MATERIAL SHALL BE EXCAVATED AND REPLACED WITH SATISFACTORY MATERIAL AND BROUGHT UP TO GRADE WITH GRAVEL BORROW CONTAINING NO STONES GREATER THAN 6" DIAMETER.
- 5.) AT ALL TIMES DURING CONSTRUCTION, THE SUB-GRADE AND ALL DITCHES SHALL BE CONSTRUCTED AND MAINTAINED SO THAT THE TRACK WILL EFFECTIVELY BE DRAINED.
- 6.) THE CONTRACTOR SHALL REFER TO THE NEWBURY PLANNING BOARD RULES AND REGULATIONS GOVERNING THE SUBDIVISION OF LAND, ARTICLES I - VIII.

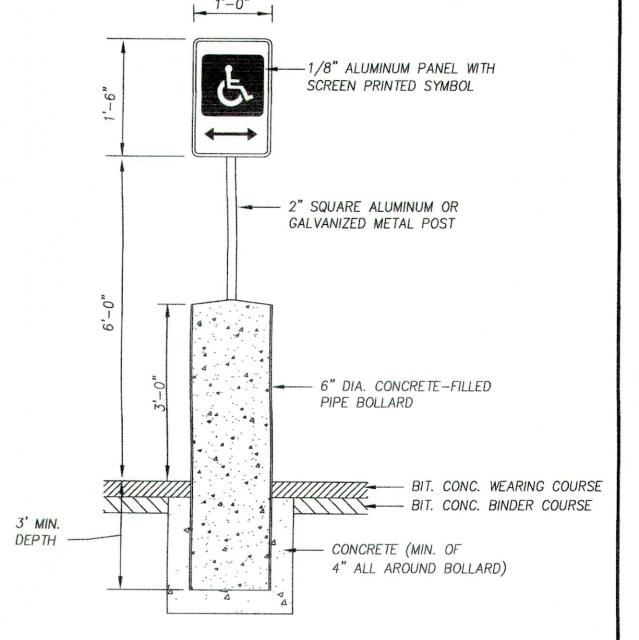

HANDICAP PARKING

SIGN DETAIL

N.T.S.



PREPARED FOR

K & R CONSTRUCTION COMPANY LLC P.O. BOX 163 BOXFORD, MA 01921

ADDRESS CONCOM COMMENTS C.M.Y. 4 2/8/21 ADDRESS REVIEWER'S COMMENTS C.M.Y. 3 12/28/20 ADDRESS REVIEWER'S COMMENTS | C.M.Y. 12/1/20 9/30/20 ADDRESS TOWN COMMENTS C.M.Y. DATE DESCRIPTION

MILLENNIUM ENGINEERING, INC. ENGINEERING AND LAND SURVEYING

62 ELM ST. SALISBURY, MA 01952 (978) 463-8980 13 HAMPTON RD. EXETER, NH 03833 (603) 778-0528

SCALE: AS NOTED ROJECT: M193680 DATE: JUL. 20, 2020

PLAN OF LAND NEWBURY, MA

SHOWING PROPOSED SITE IMPROVEMENTS

> 84 BOSTON ROAD (MAP R-36 LOT 23A)

SHEET: C-4

SITE/

DRAINAGE

DETAILS


E:\sdskproj-2019\M193680\dwg\M193680-D.dwg 2/14/2021 12:09:15 PM EST


LAYOUT


CONSTRUCTED WETLAND


HORIZ. SCALE: 1"=20'


SEMI-WET

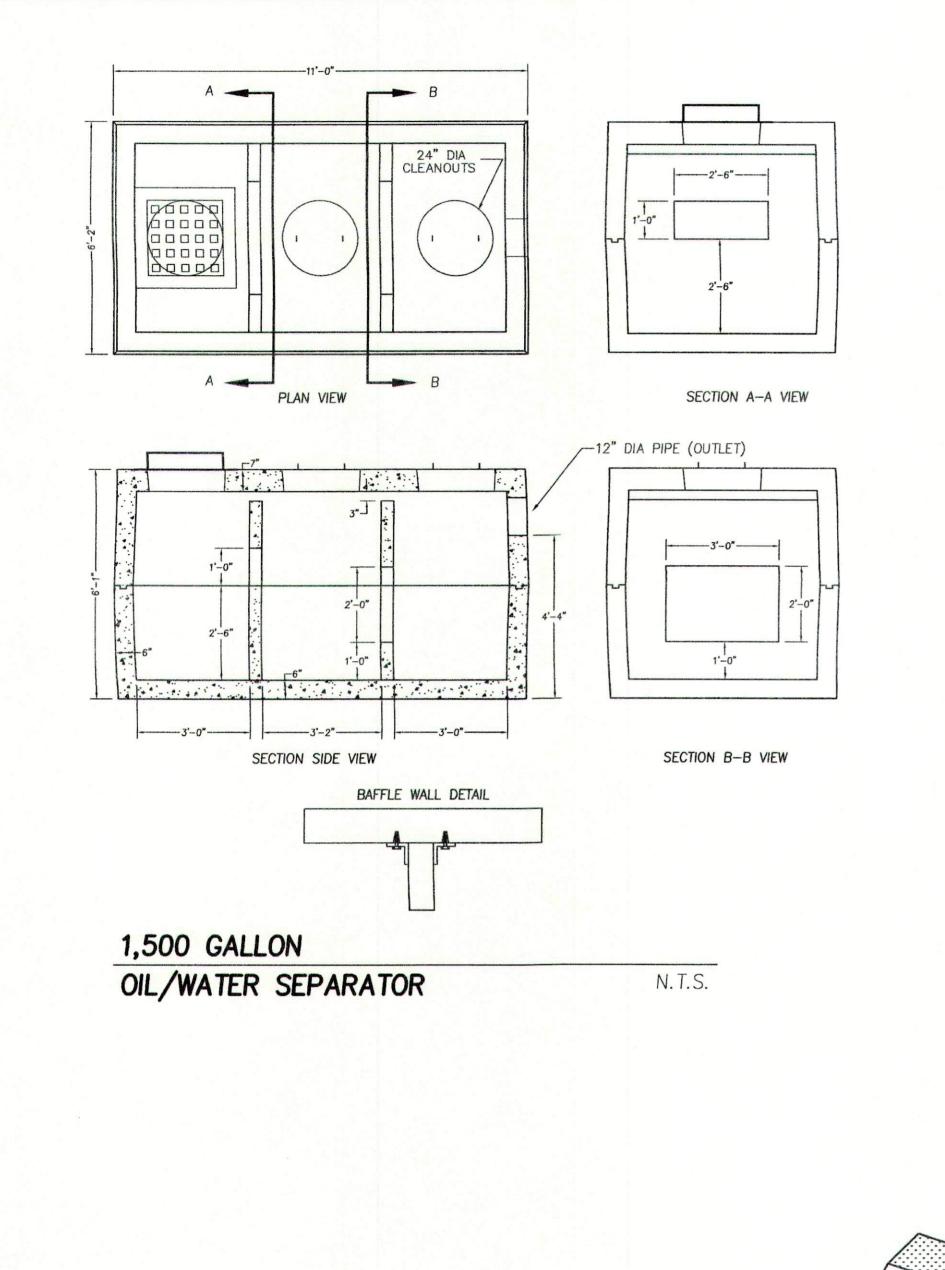

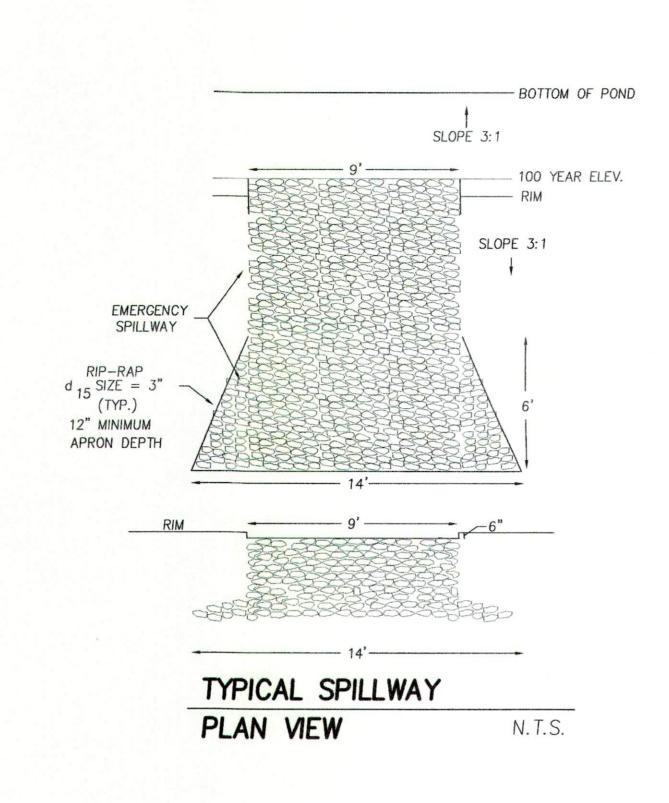


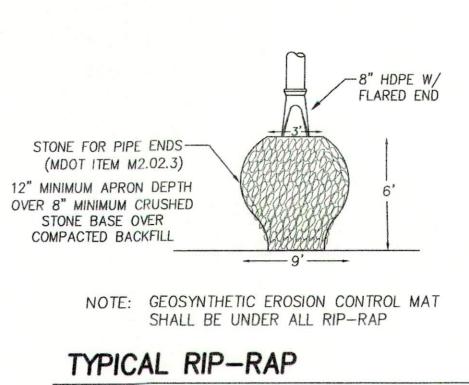





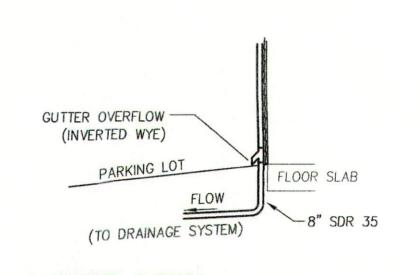

GUTTER DOWN SPOUT DETAIL N.T.S.

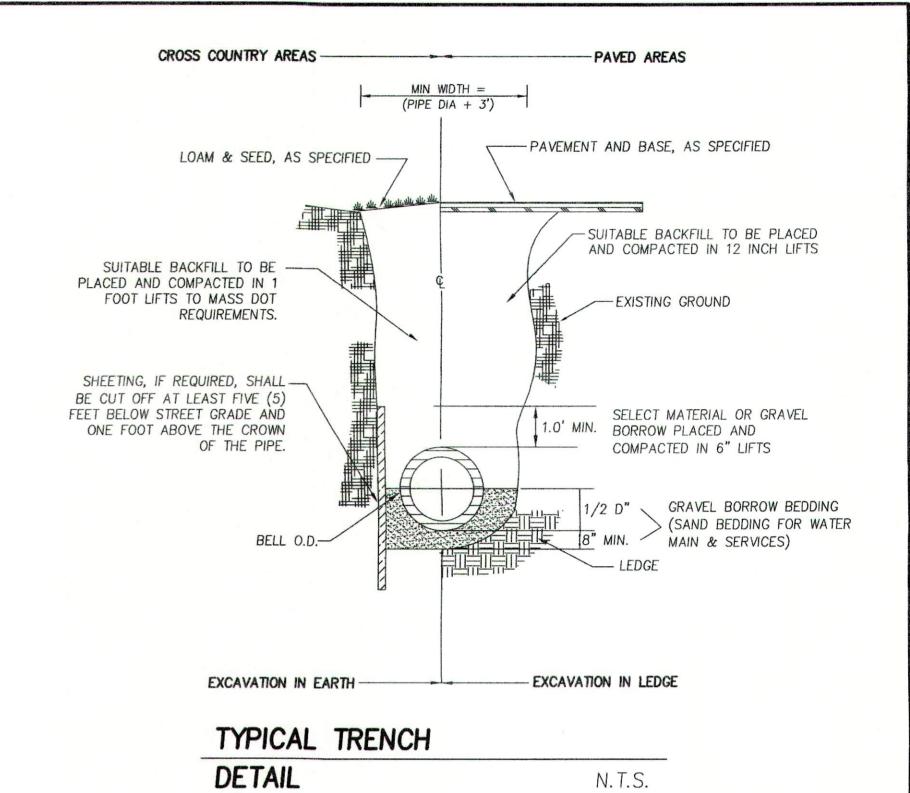


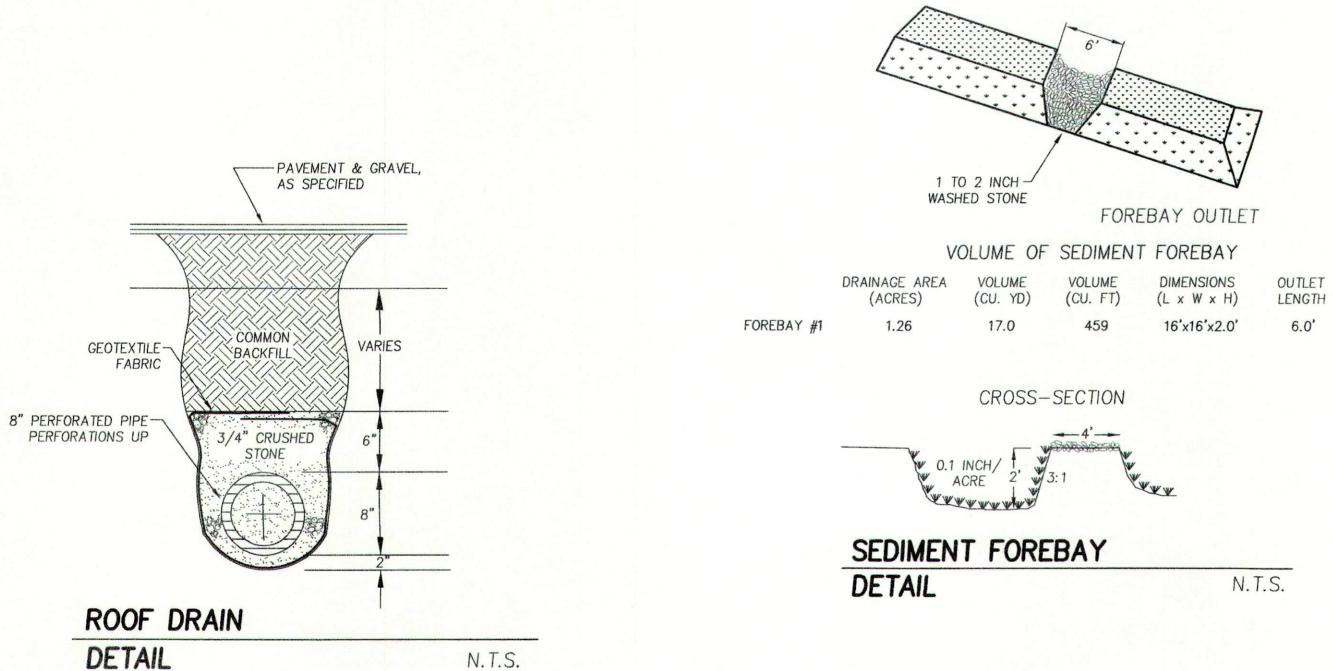

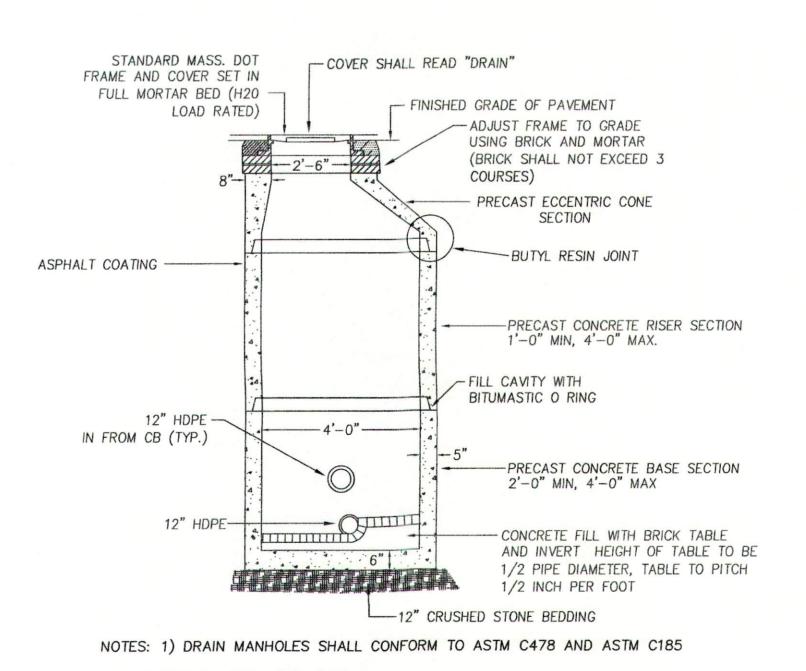

PRECAST DRAIN MANHOLE DETAIL

N.T.S.

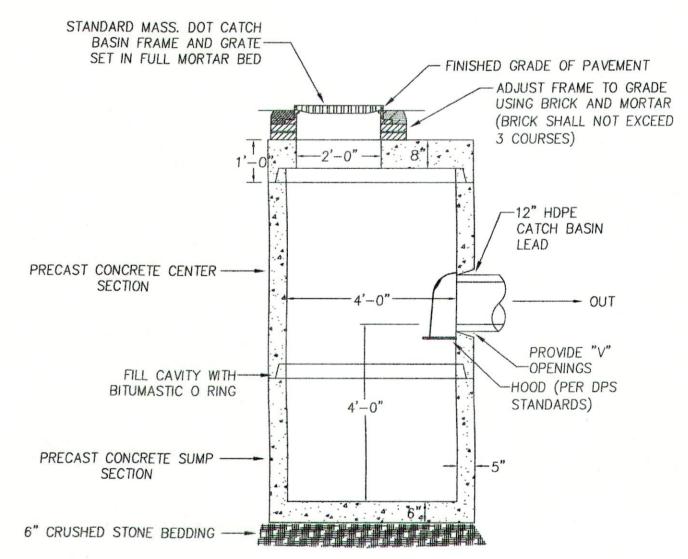


NOTES: 1) CATCH BASINS SHALL CONFORM TO ASTM C478 AND ASTM C185 2) FLAT TOP STRUCTURES SHALL BE PRECAST SECTIONS AND HAVE A 28 DAY COMPRESSIVE STRENGTH OF 5000 PSI REINFORCED FOR AASHTO H-20 LOADING.

3) CONICAL SECTIONS MAY BE SUBSTITUTED FOR FLAT-TOP STRUCTURES IN AREAS WHERE MORE THAN 4 FEET OF COVER IS PROVIDED FOR DRAIN PIPE.

PRECAST CATCH BASIN DETAIL

N.T.S.



K & R CONSTRUCTION COMPANY LLC P.O. BOX 163 BOXFORD, MA 01921

PREPARED FOR

ADDRESS CONCOM COMMENTS | C.M.Y. 4 2/8/21 3 12/28/20 ADDRESS REVIEWER'S COMMENTS C.M.Y 2 12/1/20 ADDRESS REVIEWER'S COMMENTS C.M.Y. SCALE: AS NOTED ADDRESS TOWN COMMENTS C.M.Y. 1 9/30/20 DATE: JUL. 20, 2020 NO. DATE DESCRIPTION

MILLENNIUM ENGINEERING, INC. ENGINEERING AND LAND SURVEYING

62 ELM ST. SALISBURY, MA 01952 (978) 463-8980 13 HAMPTON RD. EXETER, NH 03833 (603) 778-0528

ROJECT: M193680

DESG. BY: C.M.Y.

CHKD. BY: E.W.B.


PLAN OF LAND NEWBURY, MA SHOWING PROPOSED SITE IMPROVEMENTS 84 BOSTON ROAD

(MAP R-36 LOT 23A)

DRAINAGE **DETAILS**

SHEET: C-5

E:\sdskproj-2019\M193680\dwg\M193680-D.dwg 2/14/2021 12:09:15 PM EST

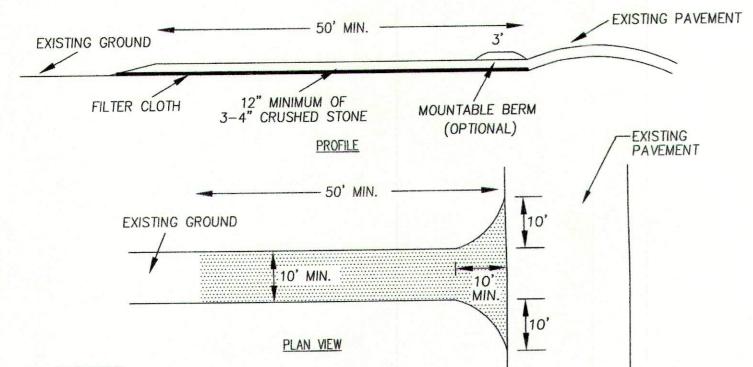

NOTES

- 1. STONE SHALL BE 3-4" STONE, RECLAIMED STONE, OR RECYCLED CONCRETE
- THE LENGTH OF THE STABILIZED ENTRANCE SHALL NOT BE LESS THAN 50'. 3. THE THICKNESS OF THE STONE FOR THE STABILIZED ENTRANCE SHALL NOT BE
- LESS THAN 12". 4. GEOTEXTILE FILTER CLOTH SHALL BE PLACED OVER THE ENTIRE AREA PRIOR TO
- PLACING THE STONE. 5. ALL SURFACE WATER THAT IS FLOWING TO OR DIVERTED TOWARD THE CONSTRUCTION ENTRANCE SHALL BE PIPED BENEATH THE ENTRANCE. IF PIPING IS IMPRACTICAL, A BERM WITH 5:1 SLOPES THAT CAN BE CROSSED BY VEHICLES MAY BE SUBSTITUTED
- 6. THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION THAT WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHTS-OF-WAY. THIS MAY REQUIRE PERIODIC TOP-DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND AND REPAIR AND/OR CLEANOUT OF ANY MEASURES USED TO TRAP SEDIMENT. ALL SEDIMENT SPILLED, WASHED, OR TRACKED ONTO PUBLIC RIGHTS-OF-WAY MUST BE REMOVED PROMPTLY.
- WHEELS SHALL BE CLEANED TO REMOVE MUD PRIOR TO ENTRANCE ONTO PUBLIC RIGHTS-OF-WAY. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH STONE WHICH DRAINS INTO AN APPROVED SEDIMENT TRAPPING DEVICE.

STABILIZED CONSTRUCTION

ENTRANCE

N.T.S.

GENERAL EROSION CONTROL NOTES

- 1. ALL SILT FENCE SHALL BE INSTALLED BEFORE THE START OF CONSTRUCTION. SILT FENCE SHALL BE REMOVED UPON COMPLETION OF THE PROJECT AND STABILIZATION OF ALL SOIL. 2. ALL FILL SHALL BE FREE OF STUMPS AND LARGE STONES. LEDGE ENCOUNTERED ONSITE CAN BE
- GROUND UP TO A MAXIMUM 3" SIZE AND USED FOR FILL. 3. ANY STANDING BODIES OF WATER CREATED DURING EXCAVATION SHALL BE ELIMINATED. 4. EROSION CONTROL BARRIERS SHALL BE INSPECTED WEEKLY AND AFTER EVERY 0.5" OF
- RAINFALL AND PROMPTLY REPAIRED OR REPLACED AS NECESSARY. 5. ACCUMULATED SEDIMENT DEPOSITS UPSTREAM OF BARRIERS SHALL BE PROPERLY DISPOSED OF ON A REGULAR BASIS.
- 6. AREAS OUTSIDE THE LIMITS OF WORK (EROSION CONTROL/SILT FENCE LOCATIONS) DISTURBED BY THE CONTRACTOR DURING CONSTRUCTION SHALL BE RESTORED TO THEIR ORIGINAL CONDITION AT THE EXPENSE OF THE CONTRACTOR.
- 7. THE CONTRACTOR IS RESPONSIBLE FOR MAINTAINING EROSION AND/OR SEDIMENT CONTROLS DURING CONSTRUCTION. HE/SHE SHALL INSPECT CONTROLS WEEKLY AND AFTER ALL STORM EVENTS. REPAIRS, IF REQUIRED, SHALL BE MADE IMMEDIATELY.
- 8. TEMPORARY GROUND COVER SHALL BE ESTABLISHED IN AREAS OF CONSTRUCTION WHERE REQUIRED BY THE NEWBURY PLANNING BOARD AND CONSERVATION COMMISSION.
- 9. ANY DISTURBED AREAS OF THE SITE NOT USED FOR ROADWAY OR UTILITY CONSTRUCTION SHALL BE STABILIZED WITH LOAM AND SEED UNTIL FURTHER DISTURBANCE IS REQUIRED FOR
- 10. AN AREA SHALL BE CONSIDERED STABILIZED IF ONE OF THE FOLLOWING HAS OCCURRED: BASE COURSE GRAVELS HAVE BEEN INSTALLED IN AREAS TO BE PAVED; A MINIMUM OF 85% VEGETATED GROWTH HAS BEEN ESTABLISHED; A MINIMUM OF 3" OF NON-EROSIVE MATERIAL SUCH AS STONE OR RIPRAP HAS BEEN INSTALLED; OR EROSION CONTROL BLANKETS HAVE BEEN PROPERLY INSTALLED.
- 11. THE CONTRACTOR SHALL IDENTIFY TO THE TOWN HIS/HER TOPSOIL STOCKPILING OPERATIONS AND
- LOCATIONS. 12. PROVIDE SILTSACK (OR APPROVED EQUAL) SEDIMENT FILTER AT ALL CATCH BASINS.
- 13. A MINIMUM OF 6" OF LOAM SHALL BE INSTALLED ON ALL DISTURBED UNPAVED SURFACES. 14. SEED MIX SHALL BE NO LESS THAN 4 LBS./1000 S.F. OF LAND AREA. SEED SHALL CONSIST OF A MAXIMUM OF 10% RYE GRASS AND A MINIMUM OF 90% PERMANENT BLUEGRASS AND/OR FESCUE.
- LIME SHALL BE APPLIED AT A RATE OF 2 TONS/ACRE. 15. NO MORE THAN 6 ACRES SHALL BE DISTURBED AT ONE TIME. ALL AREAS SHALL BE
- STABILIZED WITHIN 45 DAYS OF INITIAL DISTURBANCE. 16. WHERE PLACEMENT OF FILL IS REQUIRED FOR THE CONSTRUCTED WETLAND, FILL SHALL BE PLACED IN AN UNFROZEN STATE UPON UNFROZEN GROUND.

CONSTRUCTION SEQUENCE

- 1. INSTALL SILT FENCE AT LIMIT OF WORK & STAKE OUT CONSTRUCTED WETLAND.
- 2. CONSTRUCT STABILIZED CONSTRUCTION ENTRANCE AS DEPICTED. . CLEAR AND GRUB DEBRIS TO PHASE LINE AND DISPOSE OF PROPERLY.
- 4. STRIP, SCREEN AND STOCKPILE TOPSOIL. TOPSOIL CAN BE TEMPORARILY STOCKPILED ON SITE PROVIDING THAT THE PERIMETER OF THE STOCKPILES ARE PROPERLY STAKED WITH SILT FENCE AT THE TOE OF SLOPE.
- ROUGH GRADE CONSTRUCTED WETLAND. 6. GRADE PAVEMENT TO TOP OF SUBGRADE ELEVATIONS. ALL ROADWAYS MUST BE
- STABILIZED IMMEDIATELY AFTER GRADING.
- BEGIN BUILDING CONSTRUCTION. 8. INSTALL UTILITIES/DRAINAGE STRUCTURES.
- 9. PLACE RIPRAP WHERE SHOWN ON PLANS. LOAM AND HYDROSEED SIDESLOPES AND ALL DISTURBED AREAS WITHIN 72 HOURS.
- 10. ADD PLANTINGS TO CONSTRUCTED WETLAND. 11. SPREAD, SHAPE, AND COMPACT PAVEMENT SUBBASE AS PER TYPICAL PAVEMENT SECTION TO ATTAIN FINAL DESIGN ELEVATIONS.
- 12. PERFORM BINDER COURSE PAVING. 13. LOAM AND HYDROSEED ANY DISTURBED SURFACES ALONG EDGES OF PAVEMENT AS
- REQUIRED.
- 14. PERFORM FINAL PAVING (TOP COURSE). 15. REMOVE EROSION CONTROL.

CHRISTOPHER I YORK No. 49181

PREPARED FOR

K & R CONSTRUCTION COMPANY LLC P.O. BOX 163 BOXFORD, MA 01921

	1000				
^	4	2/8/21	ADDRESS CONCOM COMMENTS	C.M.Y.	
С	3	12/28/20	ADDRESS REVIEWER'S COMMENTS	C.M.Y.	
	2	12/1/20	ADDRESS REVIEWER'S COMMENTS	C.M.Y.	L
	1	9/30/20	ADDRESS TOWN COMMENTS	C.M.Y.	L
	NO.	DATE	DESCRIPTION	BY	

TEST PIT #08-20

EL. = 15.0

SANDY LOAM

SILT CLAY LOAM

CLAY

C₂

FINE SANDY LOAM

ESHWT = 20" = 13.3

TEST PIT #07-20

EL. = 13.0

SANDY LOAM

SILT CLAY LOAM

CLAY

C₂

FINE SANDY LOAM

ESHWT = 17" = 11.6

TEST PIT #06-20

EL. = 12.0

SANDY LOAM

LOAM

C1

FINE SANDY LOAM

FINE SANDY LOAM

ESHWT = 17" = 10.6

MILLENNIUM ENGINEERING, INC.

ENGINEERING AND LAND SURVEYING 62 ELM ST. SALISBURY, MA 01952 (978) 463-8980 13 HAMPTON RD. EXETER, NH 03833 (603) 778-0528


,		
SCALE: AS NOTED	DESG. BY: C.M.Y.	PROJECT: M193680
DATE: JUL. 20, 2020	CHKD. BY: E.W.B.	PROJECT. WT33000

OPENING 1" REBAR FOR BAG REMOVAL FROM INLET (REBAR NOT INCLUDED) OPTIONAL OVERFLOW SILTSACK DUMP LOOPS (REBAR NOT INCLUDED) SIDE VIEW INSTALLED INSTALLATION DETAIL

NOTES

- 1. TO INSTALL SILTSACK IN THE CATCH BASIN, REMOVE THE GRATE AND PLACE THE SACK IN THE OPENING. HOLD APPROXIMATELY SIX INCHES OF THE SACK OUTSIDE THE FRAME. THIS IS THE AREA OF THE LIFTING STRAPS. REPLACE THE GRATE TO HOLD THE SACK IN PLACE.
- 2. WHEN THE RESTRAINT CORD IS NO LONGER VISIBLE, SILTSACK IS FULL AND SHOULD BE EMPTIED. 3. TO REMOVE SILTSACK, TAKE TWO PIECES OF 1" DIAMETER REBAR AND PLACE THROUGH THE LIFTING LOOPS
- ON EACH SIDE OF THE SACK TO FACILITATE THE LIFTING OF SILTSACK. 4. TO EMPTY SILTSACK, PLACE UNIT WHERE THE CONTENTS WILL BE COLLECTED. PLACE THE REBAR THROUGH THE LIFT STRAPS (CONNECTED TO THE BOTTOM OF THE SACK) AND LIFT. THIS WILL LIFT SILTSACK FROM THE BOTTOM AND EMPTY THE CONTENTS. CLEAN OUT AND RINSE. RETURN SILTSACK TO ITS ORIGINAL
- SHAPE AND PLACE BACK IN THE BASIN. 5. SILTSACK IS REUSABLE. ONCE THE CONSTRUCTION CYCLE IS COMPLETE, REMOVE SILTSACK FROM THE BASIN AND CLEAN. SILTSACK SHOULD BE STORED OUT OF SUNLIGHT UNTIL NEXT USE.

SILT SACK DETAIL N.T.S.

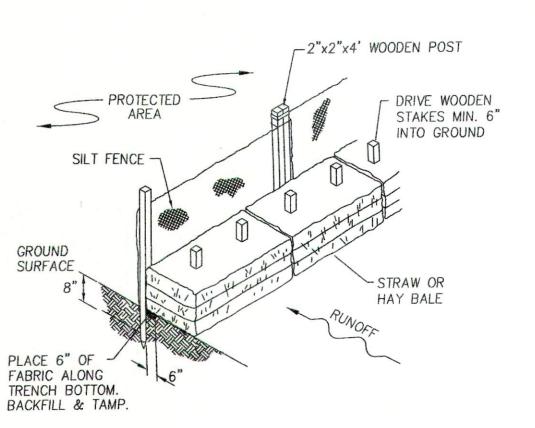

NOTES

- 1. POSTS SHALL BE DOUBLED AND COUPLED AT FILTER CLOTH SEAMS.
- 2. FILTER CLOTH TO BE FASTENED SECURELY TO SUPPORT NETTING WITH TIES SPACED EVERY 24" AT TOP, MID SECTION, AND BOTTOM.
- 3. WHEN TWO SECTIONS OF FILTER CLOTH ADJOIN EACH OTHER, THEY SHALL BE OVERLAPPED BY 6 INCHES, FOLDED AND STAPLED.

MAINTENANCE

- 1. SILT FENCE SHALL BE INSPECTED IMMEDIATELY AFTER EACH RAINFALL AND AT LEAST DAILY DURING PROLONGED RAINFALL. ANY REPAIRS THAT ARE REQUIRED SHALL BE MADE IMMEDIATELY.
- 2. IF THE FABRIC ON THE SILT FENCE SHALL DECOMPOSE OR BECOME INEFFECTIVE DURING THE EXPECTED LIFE OF THE FENCE, THE FABRIC SHALL BE REPLACED PROMPTLY.
- 3. SEDIMENT DEPOSITS SHALL BE INSPECTED AFTER EVERY STORM EVENT. THE DEPOSITS SHALL BE REMOVED WHEN THEY REACH APPROXIMATELY ONE-THIRD THE HEIGHT OF THE BARRIER.
- 4. SEDIMENT DEPOSITS THAT ARE REMOVED OR LEFT IN PLACE AFTER THE FABRIC HAS BEEN REMOVED SHALL BE GRADED TO CONFORM WITH THE EXISTING TOPOGRAPHY AND VEGETATED.

SILT FENCE/ HAYBALE INSTALLATION

> NEWBURY, MA SHOWING PROPOSED SITE IMPROVEMENTS

PLAN OF LAND

EROSION CONTROL **DETAILS**

84 BOSTON ROAD SHEET: C-6 (MAP R-36 LOT 23A)

E:\sdskproj-2019\M193680\dwg\M193680-D.dwg 2/14/2021 12:09:15 PM EST



WDGE1 LED Architectural Wall Sconce








Specifications

(without options)

Depth (D1): 1.5" Depth (D2): Width:





Introduction

Catalog Number

Notes

7ур-а


The WDGE LED family is designed to meet specifier's every wall-mounted lighting need in a widely accepted shape that blends with any architecture. The clean rectilinear design comes in four sizes with lumen packages ranging from 1,200 to 25,000 lumens, providing true site-wide solution.


WDGE1 delivers up to 2,000 lumens with a soft, non-pixelated light source, creating a visually comfortable environment. The compact size of WDGE1, with its integrated emergency battery backup option, makes it an ideal over-the-door wall-mounted lighting solution.




Specifications

Depth (D1): Depth (D2): 18" (without options)






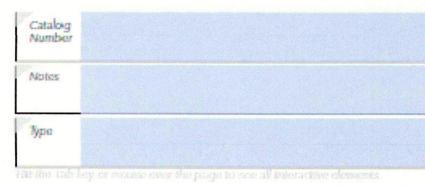

Introduction

The WDGE LED family is designed to meet specifier's every wall-mounted lighting need in a widely accepted shape that blends with any architecture. The clean rectilinear design comes in four sizes with lumen packages ranging from 1,200 to 25,000 lumens, providing a true site-wide solution. Embedded with nLight® AIR wireless controls, the WDGE family provides additional energy savings and code compliance.

WDGE3 has been designed to deliver up to 12,000 lumens through a precision refractive lens with wide distribution, perfect for augmenting the lighting from pole mounted luminaires.

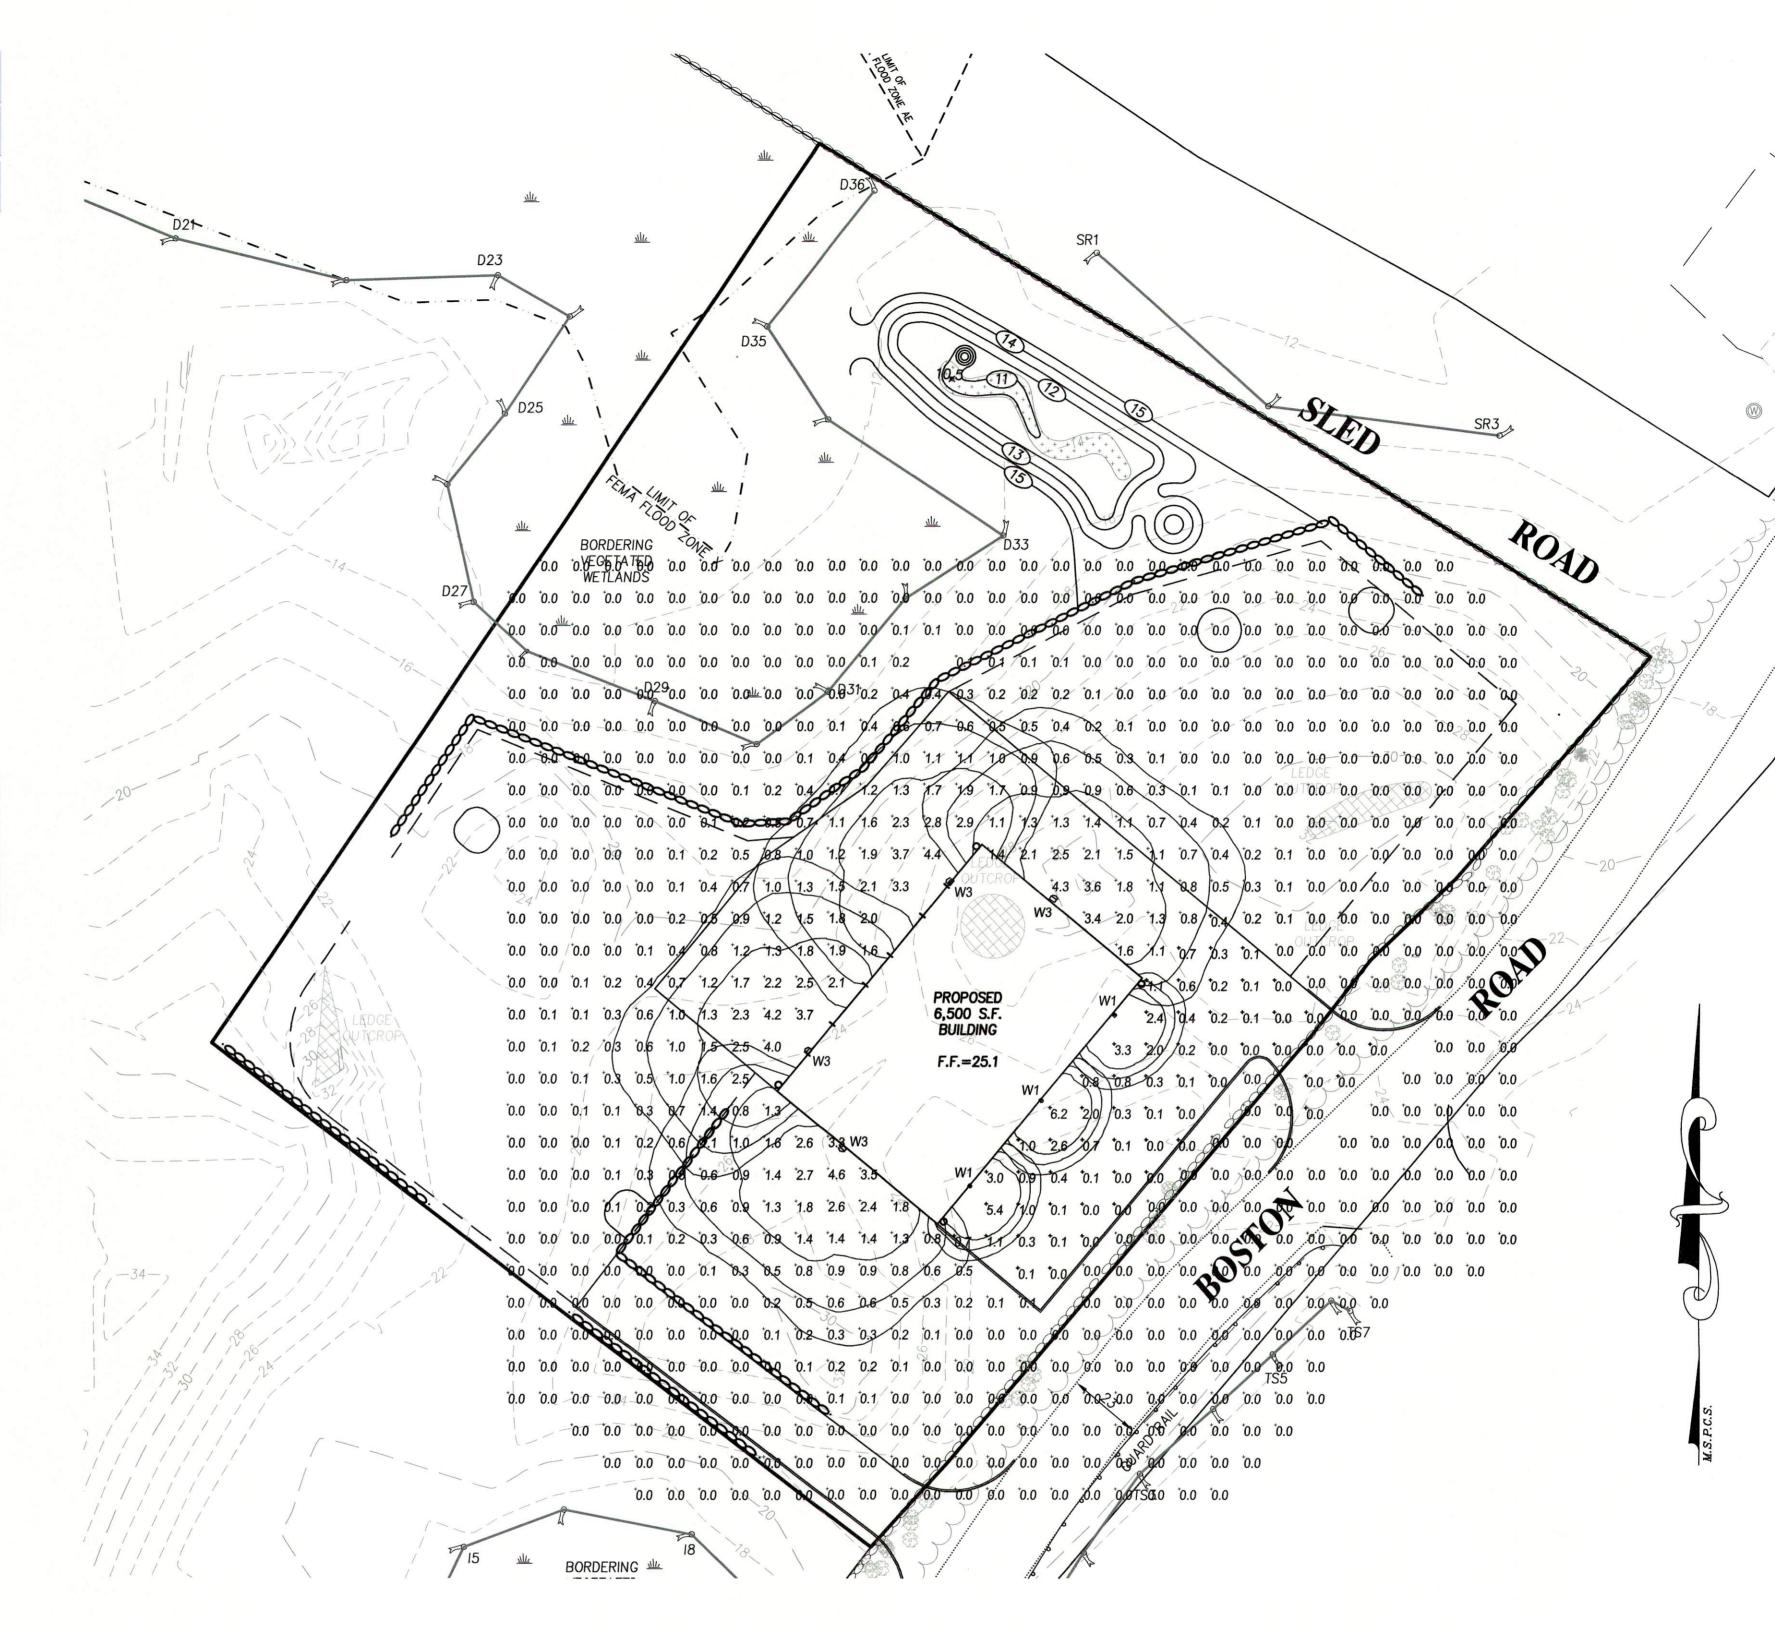


Symbol	Label	Quantity	Manufacturer	Catalog Number	Description	Lamp	Number Lamps	Filename	Lumens Per Lamp	Light Loss Factor	Wattage
	W3	4	Lithonia Lighting	WDGE3 LED P2 80CRI R4 30K	WDGE3 LED WITH P2 - PERFORMANCE PACKAGE, 3000K, 80CRI, TYPE 4 OPTIC; mounted at 18ft	LED	1	WDGE3_LED_P2 _70CRI_R4_30K .ies	8090	0.9	59.2761
	W1	3	Lithonia Lighting	WDGE1 LED P2 30K 80CRI VF	WDGE1 LED WITH P2 - PERFORMANCE PACKAGE, 3000K, 80CRI, VISUAL COMFORT FORWARD OPTIC; mounted at 10ft	LED	1	WDGE1_LED_P2 _30K_80CRI_VF .ies	1872	0.9	15.0178

Statistics								
Description	Symbol	Avg	Max	Min	Max/Min	Avg/Min		
Outside of Main Parking	+	0.2 fc	4.6 fc	0.0 fc	N/A	N/A		
Parking Lot/Main Drive	1 +	0.7 fc	6.2 fc	0.0 fc	N/A	N/A		

E: \sdskproj-2019\M193680\dwg\M193680-D-alt.dwg 3/14/2021 11:18:46 AM EDT

ol	Label	Quantity	Manufacturer	Catalog Number	Description	Lamp	Number Lamps	Filename	Lumens Per Lamp	Light Loss Factor	Wattage
	W3	4	Lithonia Lighting	WDGE3 LED P2 80CRI R4 30K	WDGE3 LED WITH P2 - PERFORMANCE PACKAGE, 3000K, 80CRI, TYPE 4 OPTIC; mounted at 18ft	LED	1	WDGE3_LED_P2 _70CRI_R4_30K .ies	8090	0.9	59.2761
Ì	W1	3	Lithonia Lighting	WDGE1 LED P2 30K 80CRI VF	WDGE1 LED WITH P2 - PERFORMANCE PACKAGE, 3000K, 80CRI, VISUAL COMFORT FORWARD OPTIC; mounted at 10ft	LED	1	WDGE1_LED_P2 _30K_80CRI_VF .ies	1872	0.9	15.0178

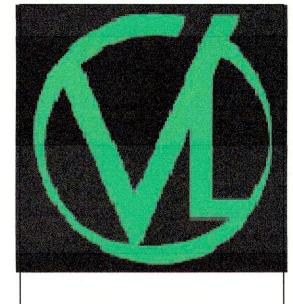



Lighting Site


Designer Heidi G. Connors Visible Light, Inc. 24 Stickney Terrace Suite 6 Hampton, NH 03842 Date 3/15/2021 Scale 1"=30" Drawing No.


Summary

E-1

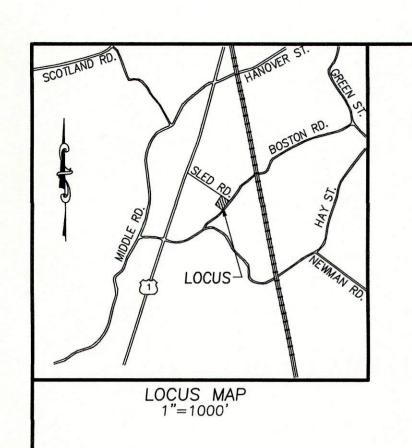

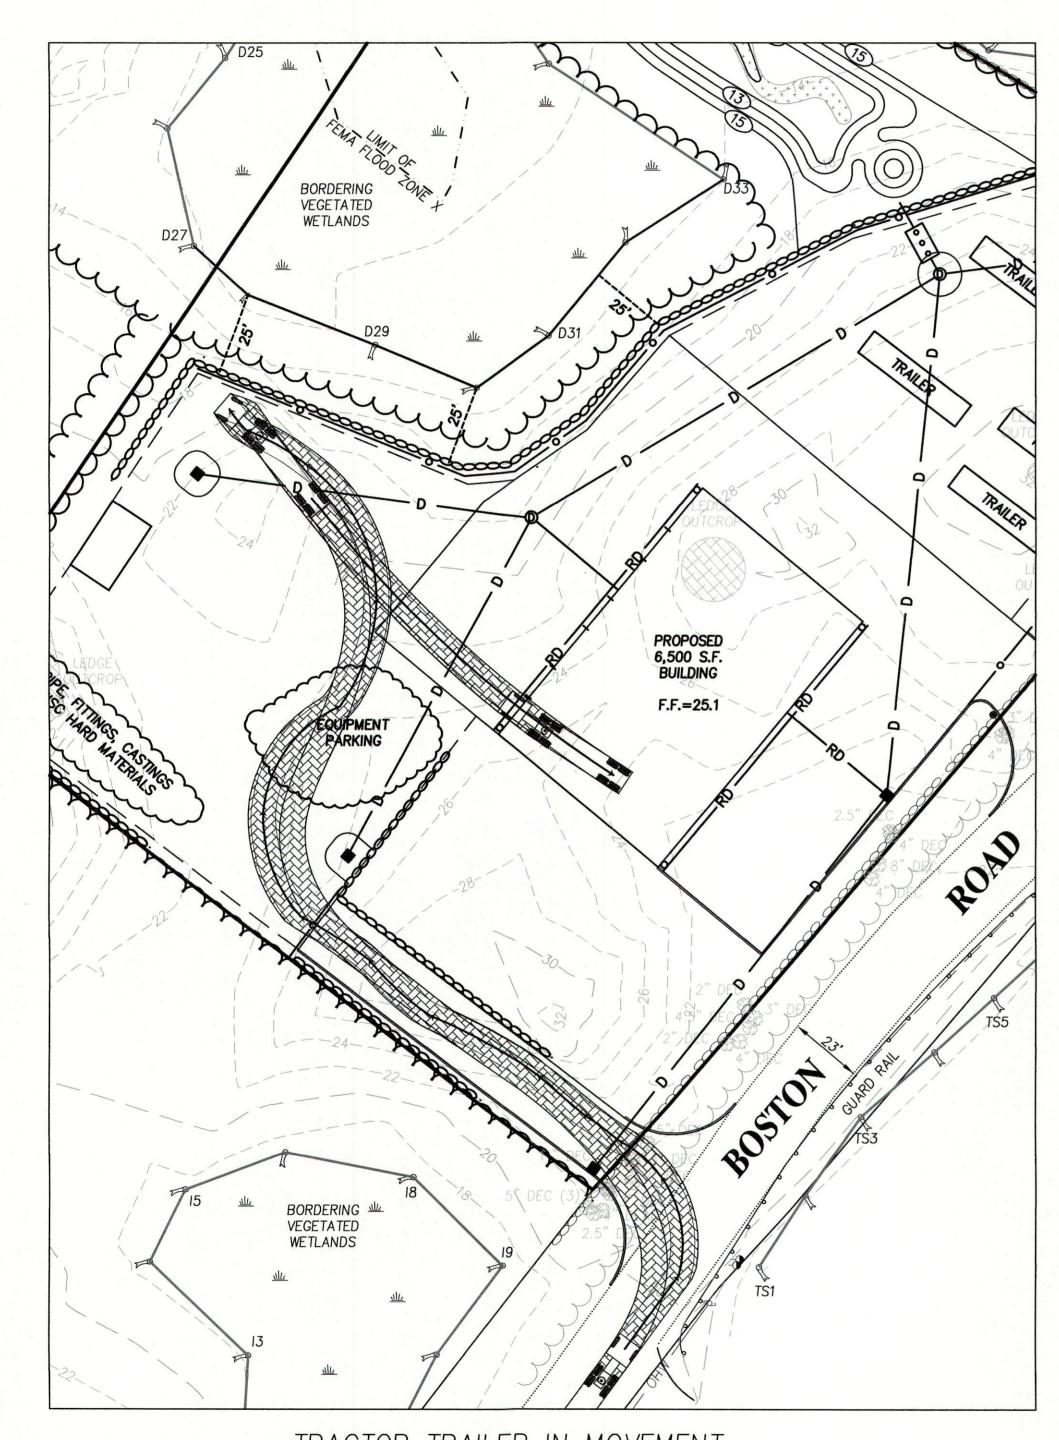

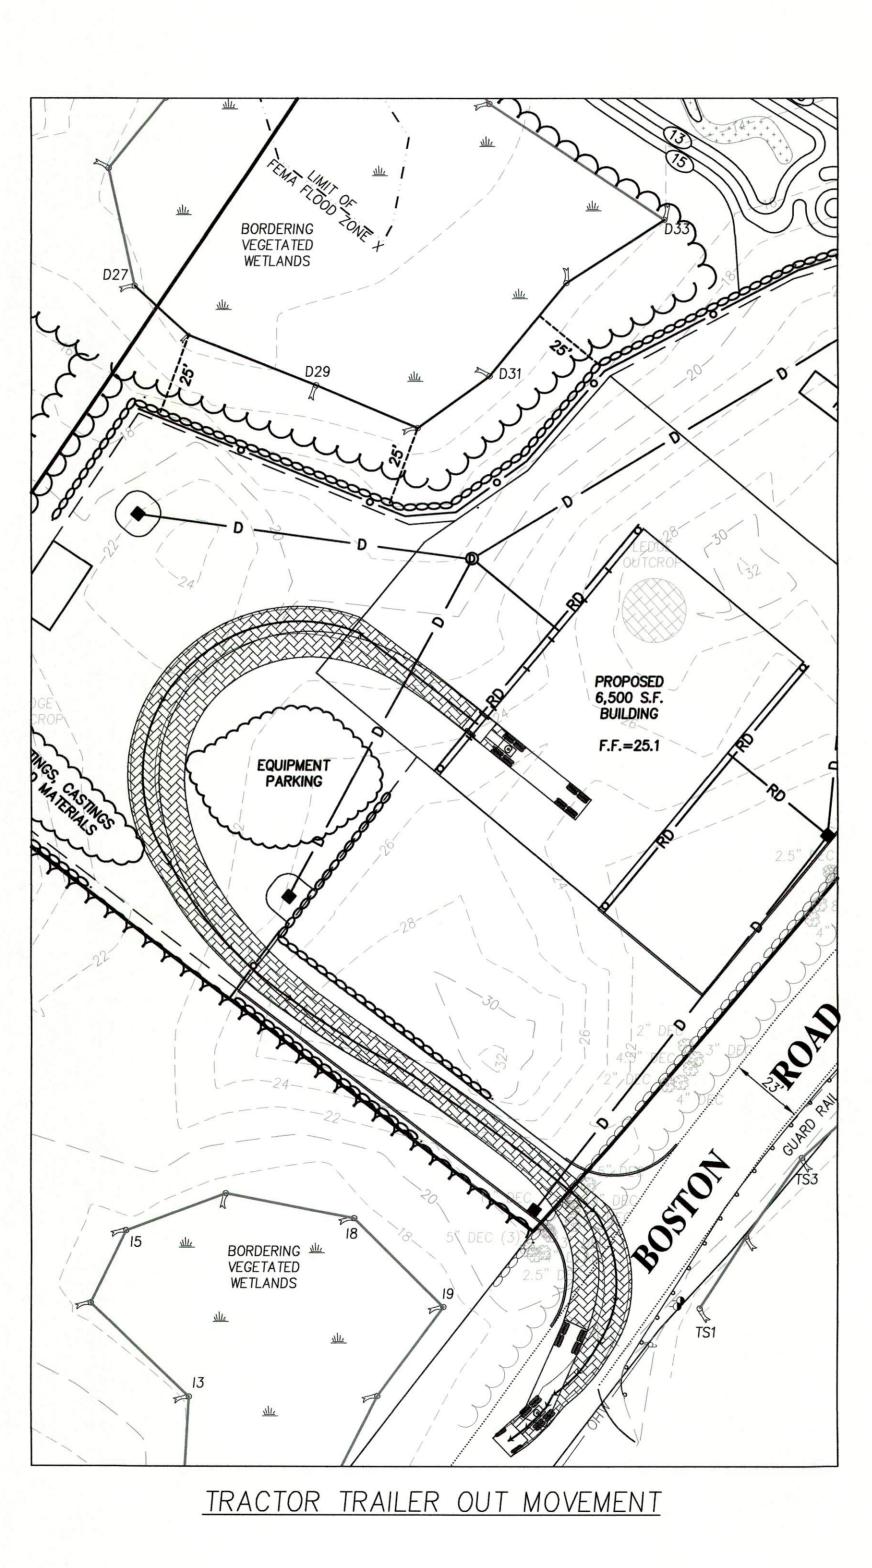


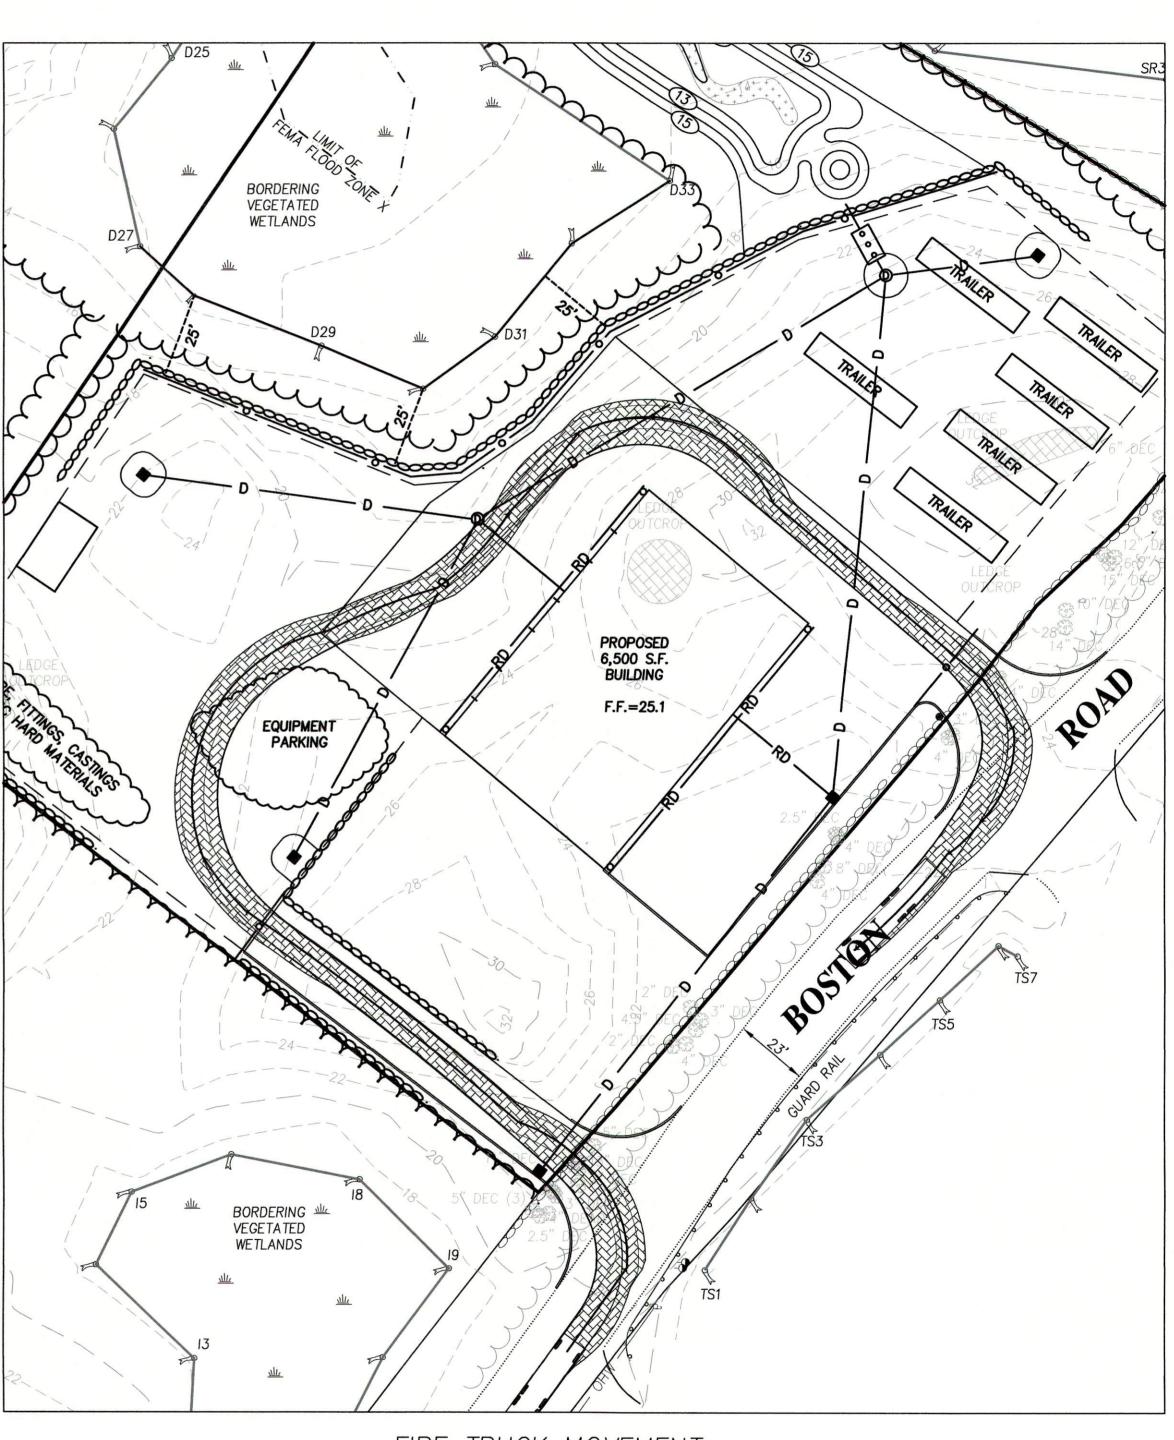


TRACTOR TRAILER IN MOVEMENT

FIRE TRUCK MOVEMENT

PROJECT: M193680

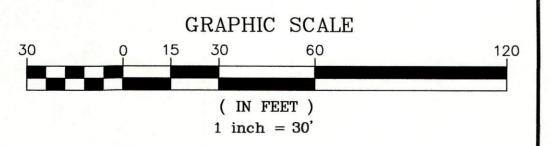



K & R CONSTRUCTION COMPANY LLC
P.O. BOX 163
BOXFORD, MA 01921

PREPARED FOR

1					İ
	5	3/15/21	REDUCE SIZE OF BUILDING	C.M.Y.	T
	4	2/8/21	ADDRESS CONCOM COMMENTS	C.M.Y.	1
	3	12/28/20	ADDRESS REVIEWER'S COMMENTS	C.M.Y.	
	2	12/1/20	ADDRESS REVIEWER'S COMMENTS	C.M.Y.	7
	1	9/30/20	ADDRESS TOWN COMMENTS	C.M.Y.	S
	NO.	DATE	DESCRIPTION	BY	D.

MILLENNIUM ENGINEERING, INC. ENGINEERING AND LAND SURVEYING
62 ELM ST. SALISBURY, MA 01952 (978) 463-8980
13 HAMPTON RD. EXETER, NH 03833 (603) 778-0528

CHKD. BY: E.W.B.

NEWBURY, MA

SHOWING
PROPOSED CONDITIONS
AT

84 BOSTON ROAD
(MAP R-36 LOT 23A)

PLAN OF LAND

TRUCK TURNING MOVEMENTS

SHEET: F-1